




VIEW A - A

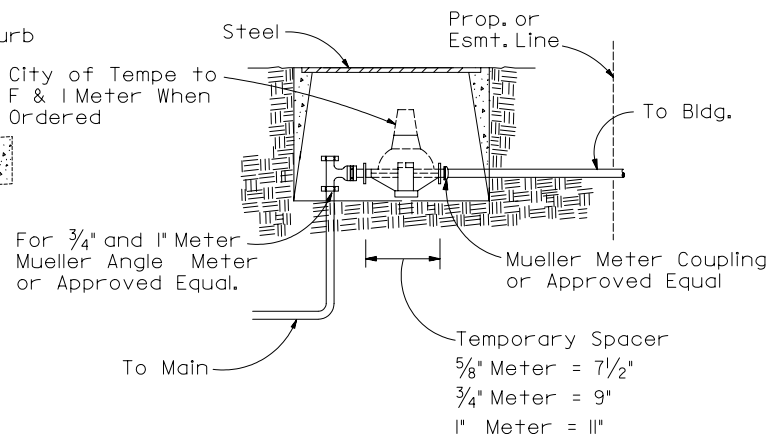

VIEW B - B

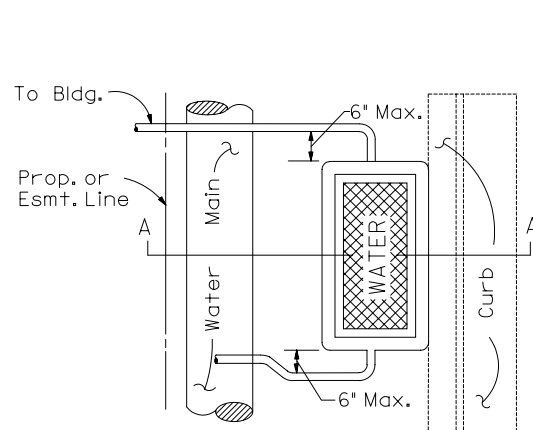

PLAN VIEW OF METER ADJACENT TO CURB
TYPE "A"

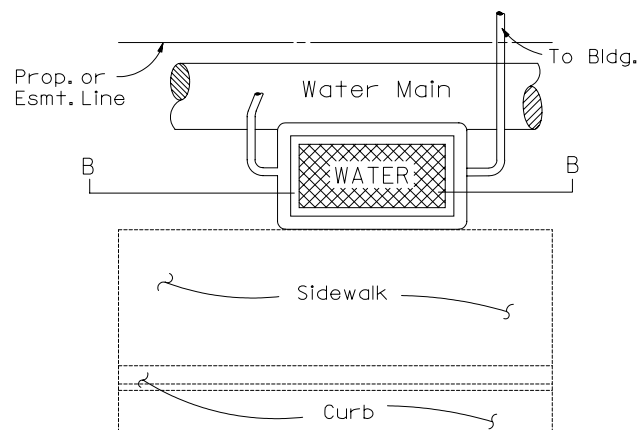

PLAN VIEW OF METER ADJACENT TO SIDEWALK
TYPE "B"

WATER SERVICES PARTS FOR ACP & DIP Saddles ($\frac{3}{4}$ " & 1" Services):

- 4" - Mueller or Approved equal
- 6" - Mueller or Approved equal
- 8" - Mueller or Approved equal
- 12" - Mueller or Approved equal

Corp. Stop ($\frac{3}{4}$ " and 1" Services):

I.P. by Copper Flare - Mueller or Approved equal

Straight Meter Coupling With Meter Swivel Nut - Mueller or Approved equal

NOTE:

Copper Service Pipe Shall Meet A.S.T.M. Spec. B-88 Type K, All New Services shall be installed with Copper only.

New Water Service Tap and/or Water Meter shall not be installed within a Driveway Entrance.

APPROVED:

ORIGINAL SIGNATURE ON FILE
AT THE CITY OF TEMPE

DEPUTY PUBLIC WORKS MANAGER
CITY ENGINEER

DATE



CITY OF TEMPE
PUBLIC WORKS DEPARTMENT

WATER METER & SERVICE INSTALLATION

DETAIL T-212

REVISED 2001